

MEP GENERAL NOTES

1. THIS IS AN EXISTING BUILDING THAT IS TO BE RENOVATED AS SHOWN. THE CONTRACTOR(S) SHALL REFERENCE THESE PLANS, THE ARCHITECTURAL PLANS AND SPECIFICATIONS, AND THE ORIGINAL BUILDING PLANS TO UNDERSTAND THE COMPLETE SCOPE OF WORK. (REQUEST ELECTRONIC COPY OF THE ORIGINAL BUILDING PLANS FROM ARCHITECT IF NECESSARY. BE AWARE THAT MEP PORTION OF ORIGINAL PLANS IS INCOMPLETE AND THERE ARE KNOWN MINOR DISCREPANCIES FROM TODAY'S EXISTING CONDITIONS.)

2. CONTRACTORS SHALL INSPECT SITE AND BUILDING CAREFULLY PRIOR TO PREPARING AND SUBMITTING A FINAL BID. INCLUDE IN BID SUFFICIENT LABOR, TEST EQUIPMENT, AND MATERIALS TO THOROUGHLY INVESTIGATE THE EXISTING CONDITIONS. DO NOT ORDER BUILDING MATERIALS OR START WORK UNTIL EXISTING CONDITIONS ARE KNOWN. UNEXPECTED CONDITIONS WILL LIKELY BE UNCOVERED DURING CONSTRUCTION. THESE SHALL BE HANDLED IN A FIRST CLASS, WORKMANLIKE MANNER. CONTACT CONSTRUCTION MANAGER, ARCHITECT, OR ENGINEER AS SOON AS POSSIBLE IF ANY SIGNIFICANT DISCREPANCIES, CONCERNS, OR POOR CONDITION OF EXISTING SYSTEMS OR MATERIALS TO BE REUSED ARE DISCOVERED.

3. THE TERM 'CONTRACTOR' IS USED TO LAY OUT THE GENERAL CONTRACTOR'S (G.C.) ULTIMATE RESPONSIBILITIES. THE G.C. SHALL BE RESPONSIBLE FOR ALL WORK AND FOR COORDINATING THE WORK AND RESPONSIBILITIES OF MECHANICAL, ELECTRICAL, PLUMBING, FIRE, AND OTHER SUB-CONTRACTORS. CONTRACTOR SHALL ALSO COORDINATE WORK WITH THE OWNER'S CONSTRUCTION MANAGER OR REPRESENTATIVE AND WITH VENDORS SUPPLYING EQUIPMENT.

4. ALL WORK SHALL BE COMPLETE, FULLY FUNCTIONAL, AND COMPLY WITH ALL NATIONAL, STATE, AND LOCAL CODES, CITY OF RICHARDSON AMENDMENTS, AND WITH THE AUTHORITIES HAVING JURISDICTION (A.H.J.). COMPLY WITH THE MOST CURRENT STANDARDS OF:

- A. 2015 IBC - INTERNATIONAL BUILDING CODE
- B. 2015 IECC - INTERNATIONAL ENERGY CONSERVATION CODE
- C. 2015 IMC - INTERNATIONAL MECHANICAL CODE
- D. 2015 IPC - INTERNATIONAL PLUMBING CODE
- E. 2014 NEC - NATIONAL ELECTRICAL CODE (NEC 70)
- F. 2010 A.D.A. - STANDARDS FOR ACCESSIBLE DESIGN
- G. NFPA 13 - INSTALLATION OF SPRINKLER SYSTEMS
- H. NFPA 72 - NATIONAL FIRE ALARM CODE
- I. NFPA 101 - LIFE SAFETY CODE
- J. LOCAL HEALTH DEPARTMENT
- K. STATE FIRE MARSHAL
- L. OSHA CODE - OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
- M. 2012 T.A.S. - TEXAS ACCESSIBILITY STANDARD

APPLY TO THE ARCHITECT FOR A LINK TO OR AN ELECTRONIC COPY OF THE ABOVE CODES AND STANDARDS IF ALLOWED. ANY WORK IN VIOLATION OF THE ABOVE SHALL BE CORRECTED BY THE CONTRACTOR AT NO COST TO THE TENANT OR OWNER.

5. MATERIALS, EQUIPMENT, APPLIANCES, AND INSTALLATION METHODS SHALL CONFORM TO THE LATEST STANDARDS OF:

- A. AIA - AMERICAN GAS ASSOCIATION
- B. AMCA - AIR MOVING AND CONDITIONING ASSOCIATION
- C. ANSI - AMERICAN NATIONAL STANDARDS INSTITUTE
- D. ADA - AMERICANS WITH DISABILITIES ACT
- E. ARI - AIR CONDITIONING AND REFRIGERATION INSTITUTE
- F. ASHRAE - AMERICAN SOCIETY OF HEATING, REFRIGERATION, AND AIR CONDITIONING ENGINEERS
- G. ASME - AMERICAN SOCIETY OF MECHANICAL ENGINEERS
- H. ASSE - AMERICAN SOCIETY OF SAFETY ENGINEERS
- I. ASTM - AMERICAN SOCIETY FOR TESTING AND MATERIALS
- J. AWWA - AMERICAN WATER WORKS ASSOCIATION
- K. CBMA - CERTIFIED BALLAST MANUFACTURERS ASSOCIATION
- L. ETL - ENVIRONMENTAL TESTING LABORATORY

M. FM - FACTORY MUTUAL
 N. IEEE - INSTITUTE OF ELECTRICAL AND ELECTRONIC ENGINEERS
 O. IES - ILLUMINATING ENGINEERING SOCIETY
 P. IPCEA - INSULATED POWER CABLE ENGINEERS ASSOCIATION
 Q. MSS - MANUFACTURERS STANDARDIZATION SOCIETY
 R. NBBPI - NATIONAL BOARD OF BOILER AND PRESSURE VESSEL INSPECTORS
 S. NECA - NATIONAL ELECTRICAL CONTRACTORS ASSOCIATION
 T. NEMA - NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
 U. NSF - NATIONAL SANITATION FOUNDATION
 V. PFI - PLUMBING AND DRAINAGE INSTITUTE
 W. SMCMA - SHEET METAL & A/C CONTRACTORS' NATIONAL ASSOCIATION
 X. TAS - TEXAS ACCESSIBILITY STANDARD
 Y. UL - UNDERWRITERS LABORATORIES INC.

6. MATERIALS SHALL BE NEW AND BEAR UNDERWRITER'S LABORATORIES (U.L.) LABEL WHERE SUCH STANDARDS HAVE BEEN ESTABLISHED.

7. ALL INFORMATION INDICATED ON THESE DRAWINGS HAS BEEN OBTAINED FROM EXISTING PLANS, REPORTS, AND PHOTOS FROM OTHERS, AND/OR FROM SITE SURVEYS. THE CONTRACTOR SHALL FIELD VERIFY AND COORDINATE ALL WORK SHOWN ON THESE DRAWINGS WITH EXISTING CONDITIONS, PRIOR TO BEGINNING WORK OR ORDERING EQUIPMENT AND MATERIAL.

8. THESE PLANS AND SPECIFICATIONS ARE SCHEMATIC AND DIAGRAMMATIC IN NATURE AND DO NOT SHOW ALL DETAILS, DEVICES, AND METHODS OF CONSTRUCTION REQUIRED IN ORDER TO ACHIEVE A FIRST CLASS, WORKMANLIKE, CODE COMPLIANT RESULT.

9. THE TERM 'PROVIDE' SHALL BE UNDERSTOOD TO MEAN FURNISH, INSPECT, INSTALL, CHARGE (AS WITH REFRIGERANT IN DX UNITS, LAMPS IN LUMINAIRES, BATTERIES, ETC.), CONNECT, ADJUST, BALANCE, TEST, AND WARRANT TO INSURE THAT EQUIPMENT OR DEVICE IS FULLY FUNCTIONAL. INSTALL SHALL INCLUDE ALL LABOR, TRANSPORTATION, INCIDENTAL MATERIAL, ERECTING EQUIPMENT, TOOLS, TEST EQUIPMENT, ETC.

10. PRIOR TO SUBMITTING A FINAL BID, CONTRACTORS SHALL:

- A. STUDY THE ORIGINAL BUILDING PLANS AND THE NEW ARCHITECTURAL, STRUCTURAL, MECHANICAL, PLUMBING, AND ELECTRICAL PLANS AND SPECIFICATIONS.
- B. VISIT THE SITE AND PERFORM A THOROUGH EXAMINATION AND EVALUATION OF ALL EXISTING CONDITIONS.
- C. NOTIFY THE ARCHITECT IN WRITING OF ANY SIGNIFICANT DISCREPANCY BETWEEN THE EXISTING CONDITIONS AND THE DOCUMENTS NOTED ABOVE.
- D. CONTACT THE ARCHITECT OR THE ENGINEER IF FURTHER DIRECTION OR ADDITIONAL EXPLANATION IS REQUIRED ON ANY ITEM.
- E. INCLUDE IN ALLOWANCE IN THE BID TO COVER ANY ADDITIONAL COST DUE TO NOTED DISCREPANCIES, EXISTING CONDITIONS, OBSERVATIONS, ETC.

NO EXTRAS WILL BE ALLOWED FOR EXISTING CONDITIONS WHICH COULD HAVE BEEN READILY OBSERVED OR INFERRED FROM THE EXISTING CONDITIONS OR FROM THE PLANS.

9. CONTRACTOR SHALL PAY FOR AND OBTAIN ALL PERMITS REQUIRED FOR WORK AND SHALL SCHEDULE INSPECTIONS WITH A.H.J. IN A TIMELY MANNER TO ALLOW COMPLETION OF PROJECT ON SCHEDULE.

10. THE FIRE DETECTION AND FIRE PROTECTION (SPRINKLER) SYSTEMS SHALL BE MODIFIED AS REQUIRED AS A DESIGN / BUILD EFFORT BY A STATE LICENSED, LOCALLY EXPERIENCED, FIRE ALARM AND FIRE SPRINKLER SUB-CONTRACTORS. IT SHALL BE THE CONTRACTORS' RESPONSIBILITY TO SUBMIT PLANS IN COMPLIANCE WITH N.F.P.A., N.E.C., AND LOCAL CODE AND OBTAIN APPROVAL FROM THE FIRE MARSHAL OR A.H.J. DO NOT REUSE THE EXISTING DETECTORS AND DEVICES WITHOUT THE EXPRESS, WRITTEN, APPROVAL OF THE AUTHORITIES.

11. CONTRACTOR SHALL REQUEST UTILITY COMPANIES LOCATE AND MARK ALL UNDERGROUND WATER PIPES, SANITARY SEWERS, GAS PIPES, ELECTRICAL AND COMMUNICATIONS CONDUITS AND DUCTBANKS, ETC. PRIOR TO DIGGING OR TRENCHING ON SITE. CONTRACTOR SHALL BE FULLY RESPONSIBLE AND BEAR COST FOR REPAIRING ANY UTILITY DAMAGE ON SITE.

12. CONTRACTOR SHALL TAKE EXTREME PRECAUTION TO PROTECT EXISTING CONSTRUCTION AND ADJACENT PROPERTY. CONTRACTOR SHALL BE FULLY RESPONSIBLE AND BEAR COST FOR REPAIRING ANY DAMAGE TO EXISTING PROPERTY.

13. CONTRACTOR AND ALL SUB-CONTRACTORS SHALL BE FULLY LICENSED WITH STATE AND MUNICIPALITY WHERE REQUIRED AND SHALL BE EXPERIENCED IN ALL AREAS OF THEIR WORK. CONTRACTORS SHALL BE FAMILIAR WITH LOCAL CODES AND REQUIREMENTS AFFECTING THEIR WORK.

14. REVIEW PLANS AND SPECIFICATIONS, VERIFY DIMENSIONS AND FIELD CONDITIONS, AND CONFIRM THAT WORK IS BUILDABLE AS SHOWN. REPORT ANY CONFLICTS OR OMISSIONS TO THE ARCHITECT OR ENGINEER FOR CLARIFICATION PRIOR TO ORDERING MATERIALS OR PERFORMING ANY WORK IN QUESTION.

15. WHERE A DISCREPANCY MAY EXIST BETWEEN WHAT IS SHOWN ON THE PLANS AND WHAT IS DESCRIBED BY NOTE OR SPECIFICATION, THE CONTRACTOR SHALL PROVIDE THE GREATER QUANTITY, THE BETTER QUALITY, THE MORE STRINGENT, AND GREATER COST ITEM(S) OR REQUEST CLARIFICATION FROM ARCHITECT PRIOR TO SUBMITTING FINAL BID.

16. CONTRACTOR SHALL CAREFULLY INSPECT ALL EQUIPMENT RECEIVED AND VERIFY THAT IT IS COMPATIBLE WITH THE MECHANICAL, ELECTRICAL, AND PLUMBING SYSTEMS PRIOR TO INSTALLING EQUIPMENT. CONTACT ARCHITECT OR ENGINEER FOR DIRECTION IF ANY SIGNIFICANT DISCREPANCY ARISES.

17. ALL MATERIAL AND EQUIPMENT SHALL FIT IN THE SPACE AVAILABLE. ALL DIMENSIONS AND CLEARANCES SHALL BE VERIFIED AT THE FACILITY BEFORE COMMENCING WORK. ALL WORKING CLEARANCES AROUND EQUIPMENT SHALL BE MAINTAINED IN ACCORDANCE WITH THE MANUFACTURER'S REQUIREMENTS.

18. MINOR WORK SO AS TO BE READILY ACCESSIBLE FOR OPERATION, MAINTENANCE AND REPAIR. MINOR DEVIATIONS FROM DRAWINGS MAY BE MADE TO ACCOMPLISH THIS, BUT CHANGES WHICH INVOLVE EXTRA COST SHALL NOT BE MADE WITHOUT APPROVAL.

19. SUBMITTALS AND SUBSTITUTIONS: THE CONTRACTOR SHALL SUBMIT INFORMATION TO THE ENGINEER FOR ALL EQUIPMENT, DEVICES, AND PIPING COMPONENTS INTENDED TO BE PROVIDED FOR THIS PROJECT. ALL SUBSTITUTIONS FOR EQUIPMENT AND MATERIALS OTHER THAN WHAT IS SPECIFIED SHALL BE HIGHLIGHTED AND SUBMITTED FOR REVIEW PRIOR TO INSTALLATION.

20. MATERIALS USED IN AIR PLENUMS, DUCTS, AIR HANDLING EQUIPMENT, AND WHERE REQUIRED BY A.H.J. SHALL HAVE A MAXIMUM FLAME SPREAD OF 25 AND SMOKE DEVELOPMENT OF 50 AS TESTED IN ACCORDANCE WITH NFPA-255, UL723, AND ASTM E84. DO NOT USE PAC IN RETURN AIR PLENUMS. USE ONLY PLENUM RATED MATERIALS IN RETURN AIR PLENUMS AND REQUIRED SPACES.

21. PIPE HANGERS AND SUPPORTS SHALL COMPLY WITH MSS SP-58-2009. INSTALLATION METHODS SHALL COMPLY WITH MSS SP-69-2009. PROTECT INSULATION WITH SECTION OF CALCIUM SILICATE PIPE INSULATION AND A HALF-ROUND SHEETMETAL SHIELD ON THE OUTSIDE OF INSULATION. SHIELD SHALL BE 12" LONG OR SHALL EXTEND 2" BEYOND EITHER SIDE OF HANGER (IF LONGER).

22. CONTRACTOR SHALL USE EXTREME CARE IN SELECTION AND MOUNTING METHODS FOR INSTALLATION OF EQUIPMENT TO INSURE THAT NOISE AND VIBRATION ARE HELD TO A MINIMUM. USE VIBRATION ISOLATORS, SPRINGS, DAMPENING MATERIALS, ETC. WHERE REQUIRED. ON MOTOR DRIVEN SYSTEMS EXCEEDING 1/2 HP, PROVIDE VIBRATION ISOLATION AS RECOMMENDED BY THE EQUIPMENT MANUFACTURER OR EQUAL TO KINETICS NOISE CONTROL WHERE NO RECOMMENDATION IS MADE.

23. REFER TO ARCHITECT'S SPECIFICATIONS AND NOTES FOR CUTTING, TRENCHING, AND PATCHING. PAINT ALL CONDUIT, PIPING, DUCTS, DIFFUSERS, AND DEVICES EXPOSED TO PUBLIC PER ARCHITECTURAL PLANS OR TO MATCH ADJACENT BUILDING SURFACE, UNLESS NOTED OTHERWISE.

24. UNLESS OTHERWISE SPECIFIED, ALL REQUIRED CUTTING AND PATCHING OF FLOORS, WALLS, PARTITIONS AND OTHER MATERIALS IN THE BUILDING IS TO BE INCLUDED IN THE SCOPE. THE CONTRACTOR SHALL RESTORE THESE AREAS TO ORIGINAL CONDITION UPON COMPLETION. ALL PENETRATIONS OF WALLS, CEILINGS, OR FLOORS SHALL BE CORE-DRILLED, SLEEVED, AND SEALED TO COMPLY WITH RESPECTIVE BUILDING CODE REQUIREMENTS. ALL PENETRATIONS THROUGH FIRE RATED WALL SHALL COMPLY WITH UL LISTED SLEEVE ASSEMBLY REQUIREMENTS.

25. CONTRACTOR SHALL INCLUDE AND GUARANTEE FULL MAINTENANCE AND EMERGENCY SERVICE CALLS AGAINST DEFECTIVE MATERIALS AND WORKMANSHIP FOR A PERIOD OF ONE YEAR FROM FINAL ACCEPTANCE OF FACILITY ON ALL FURNISHED EQUIPMENT AND DEVICES. CONTRACTOR'S INSTALLATION. THIS SHALL INCLUDE COST OF LABOR AND MATERIALS REQUIRED FOR REPLACEMENT OF DEFECTIVE PARTS OR IMPROPER WORKMANSHIP TO INSURE CONTINUOUS OPERATION OF ALL SYSTEMS.

26. CONTRACTOR SHALL COLLECT AND FURNISH TO OWNER ALL OPERATIONS AND MAINTENANCE MANUALS FOR INSTALLED EQUIPMENT AS WELL AS WARRANTIES AND GUARANTEES FOR SAME. FURNISH FOUR (4) SETS, UNLESS NOTED OTHERWISE. TURN OVER PRIOR TO REQUESTING FINAL PAYMENT.

27. CONTRACTORS SHALL MAINTAIN CLEAN SETS OF PLANS ON JOBSITE, NOTING DAILY CHANGES MADE IN PLANS (RED-LINES). RED-LINED DRAWINGS MUST BE KEPT CURRENT AND REFLECT ALL ACTUAL ASPECTS OF THE INSTALLATION THAT DEVIATE FROM RECORD DESIGN DRAWINGS. PROVIDE NEATLY DRAWN AND LETTERED AS-BUILT DRAWINGS WITH MATERIAL, SIZES, DIMENSIONED LOCATIONS, COORDINATE OF UNDERGROUND PIPES, UTILITIES FOUND IN FIELD, ETC. PRIOR TO REQUESTING FINAL PAYMENT.


28. THE CONTRACTOR SHALL KEEP ALL EQUIPMENT AND MATERIALS, AND ALL PARTS OF THE BUILDING, EXTERIOR SPACES AND ADJACENT STREETS, SIDEWALKS AND PAVEMENTS, FREE FROM MATERIAL AND DEBRIS RESULTING FROM THE EXECUTION OF THIS WORK. EXCESS MATERIALS WILL NOT BE PERMITTED TO ACCUMULATE EITHER ON THE INTERIOR OR THE EXTERIOR.

29. ALL EQUIPMENT AND CONSTRUCTION DEBRIS SHALL BE REMOVED UNDER THIS CONTRACT. OWNER SHALL BE GIVEN OPPORTUNITY TO KEEP ANY AC EQUIPMENT OR PLUMBING FIXTURES THAT ARE REPLACED ON PROJECT. COORDINATE AC EQUIPMENT AND OTHER EQUIPMENT WITH THE OWNER'S REPRESENTATIVE, CONSTRUCTION MANAGER, OR ARCHITECT. ALL DEBRIS AND OTHER UNCLAIMED DEMO'D EQUIPMENT SHALL BE PROPERLY DISPOSED OF BY THIS CONTRACTOR.

30. UPON COMPLETION OF WORK, PRIOR TO APPLYING FOR FINAL PAYMENT, THOROUGHLY CLEAN ALL EXPOSED PORTIONS OF MECHANICAL, ELECTRICAL, AND PLUMBING EQUIPMENT, AND TOUCH UP PAINT WHERE NECESSARY. FOLLOW MANUFACTURER'S RECOMMENDATIONS FOR CLEANING.

31. THE FINAL ACCEPTANCE WILL BE MADE AFTER THE CONTRACTOR HAS ADJUSTED THE DIMENSIONS OF THE DRAWINGS AND SPECIFICATIONS AND HAS FURNISHED ALL THE REQUIRED CERTIFICATES OF INSPECTION AND APPROVAL TO THE ARCHITECT/OWNER.

COVERING PLUMBING DESIGN

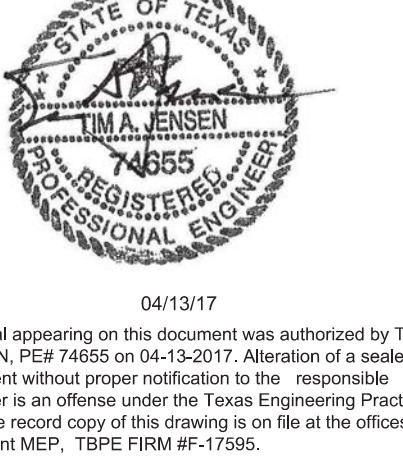

The seal appearing on this document was authorized by TIM JORJEN, P.E. #98457 on 04-12-2017. Alteration of a sealed document without proper notification to the responsible engineer is an offense under the Texas Engineering Practice Act. The record copy of this drawing is on file at the office of FourPoint MEP, 1301 Abrams Rd., Richardson, TX 75081.

BINNERI PRESBYTERIAN CHURCH
 RICHARDSON, TX
 1301 ABRAMS RD.
 RICHARDSON, TEXAS 75081

COMcheck Software Version 4.0.5.1
 Interior Lighting Compliance Certificate

Project Information
 Energy Code: 2015 IECC
 Project Title: Binneri Presbyterian Church
 Project Type: Alteration

Construction Site: 1301 Abrams Rd, Richardson, TX 75081
 Owner/Agent: Damon Drennan, poole+drennan, 931 N. Edgefield Ave, Dallas, TX 75208, 888-707-0104, ddrennan@poole+drennan.com
 Designer/Contractor: FourPoint MEP, 2525 Millington Dr, Plano, TX 75093, 214-635-4637

A Area Category	B Floor Area (ft2)	C Allowed Watts / ft2	D Allowed Watts (B X C)
1-Religious Building	21625	1.00	21625
		Total Allowed Watts = 21625	

A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast	B Lamps/ Fixture	C # of Fixtures	D Watt. (C X D)
Religious Building (21625 sq.ft.)			
LED 5; C1: Recessed Can LED Other:	1	14	203
LED 5 copy 1; C2: 3.0 ft. per ft. Other:	1	26	330
LED 8; L1: LED Ribbon 2.1 watts per ft. Other:	1	161	483
LED 4; L2: LED Ribbon 2.2w per ft. Other:	1	100	340
LED 5 copy 4; L3: Ribbon/ya 1.5watts per ft. Other:	1	40	280
LED 5 copy 2; L4: Ribbon/ya 1.5watts per ft. Other:	1	18	54
LED 5 copy 4; L5: Ribbon/ya 1.5watts per ft. Other:	1	60	270
LED 3; P1:P1-EM SURFACE CAN LED Other:	1	152	456
LED 5 copy 2; P2: Pendant Other:	1	4	240
LED 1; T1:T1-EM 2'X2' LED Other:	1	10	400
LED 1 copy 1; T2: 2'X4' LED Other:	1	3	50
Linear Fluorescent 1; T3: Fluor. shop light: 48" T8 32W (Super T8): Electronic:	2	7	44
LED 6; T4:T4-EM: 4 ft. Linear Recessed LED: LED Linear 18W:	1	9	43
		Total Proposed Watts = 10427	

Interior Lighting PASSES

Interior Lighting Compliance Statement
 Compliance Statement: The proposed interior lighting alteration project represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed interior lighting systems have been designed to meet the 2015 IECC requirements in COMcheck Version 4.0.5.1 and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

Project Title: Binneri Presbyterian Church
 Data filename: G:\PROJECTS\PD\DD\1611 - Binneri Church Remodel\MEP Calcs\DD1611 Binneri Check Page 1 of 9
 Phase: Lck

Report date: 04/12/17
 Page 1 of 9

Bryan Chadwick PE
 Name - Title
 Signature
 Date: 4-12-17

Project Title: Binneri Presbyterian Church
 Data filename: G:\PROJECTS\PD\DD\1611 - Binneri Church Remodel\MEP Calcs\DD1611 Binneri Check Page 2 of 9

Report date: 04/12/17
 Page 2 of 9

COMcheck Software Version 4.0.5.1
 Mechanical Compliance Certificate

Project Information
 Energy Code: 2015 IECC
 Project Title: Binneri Presbyterian Church
 Location: Richardson, Texas
 Climate Type: 3a
 Project Type: Alteration

Construction Site: 1301 Abrams Rd, Richardson, TX 75081
 Owner/Agent: Damon Drennan, poole+drennan, 931 N. Edgefield Ave, Dallas, TX 75208, 888-707-0104, ddrennan@poole+drennan.com
 Designer/Contractor: FourPoint MEP, 2525 Millington Dr, Plano, TX 75093, 214-635-4637

Mechanical Systems List

Quantity	System Type & Description
2	Water Heater 1: Electric Instantaneous Water Heater, Capacity: 0 gallons No minimum efficiency requirement applies

Mechanical Compliance Statement
 Compliance Statement: The proposed mechanical alteration project represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed mechanical systems have been designed to meet the 2015 IECC requirements in COMcheck Version 4.0.5.1 and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

Signature: Tim Jorjen, P.E.
 Date: 4.12.2017

Project Title: Binneri Presbyterian Church
 Data filename: G:\PROJECTS\PD\DD\1611 - Binneri Church Remodel\MEP Calcs\DD1611 Binneri Check Page 3 of 9


Report date: 04/12/17
 Page 3 of 9

COVERING MECHANICAL DESIGN COVERING ELECTRICAL DESIGN



The seal appearing on this document was authorized by TIM JORJEN, P.E. #98457 on 04-12-2017. Alteration of a sealed document without proper notification to the responsible engineer is an offense under the Texas Engineering Practice Act. The record copy of this drawing is on file at the office of FourPoint MEP, 1301 Abrams Rd., Richardson, TX 75081.

The seal appearing on this document was authorized by M. BRYAN CHADWICK, P.E. #96994 on 04-12-2017. Alteration of a sealed document without proper notification to the responsible engineer is an offense under the Texas Engineering Practice Act. The record copy of this drawing is on file at the office of FourPoint MEP, 1301 Abrams Rd., Richardson, TX 75081.

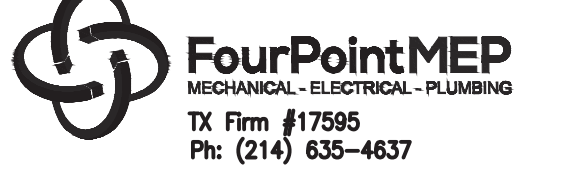

PROJECT NO.: 16054

SHEET TITLE: MEP GENERAL NOTES & ENERGY COMPLIANCE

SHEET NO.: MEP001

FILE: G:\PROJECTS\PD\DD\1611 - Binneri Church Remodel\Drawings\MEP001 - PDD1611.dwg
 SCALE: 1 DATE/TIME: Apr 13, 2017 9:35am
 USER: FourPointMEP3 XREF(g): PDD1611 - ARCH - TB.dwg